

ALLEN & HEATH






WARNING – HIGH VOLTAGES

Power Supply Unit (PSU) work should only be carried out by qualified personnel.

We recommend that you use an approved Allen & Heath service centre for all power supply work.

Please contact your local Allen & Heath distributor for more details.

<http://www.allen-heath.com/>

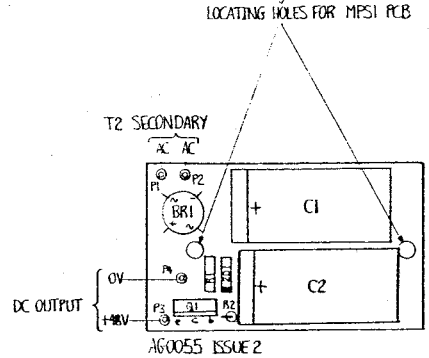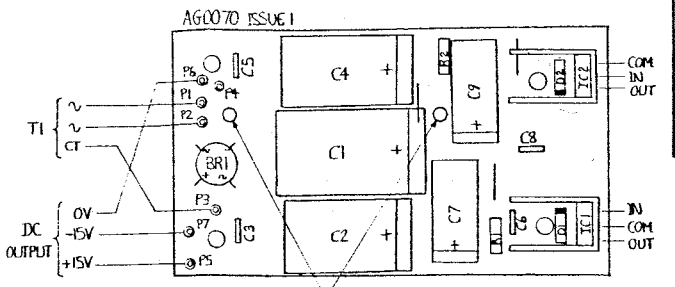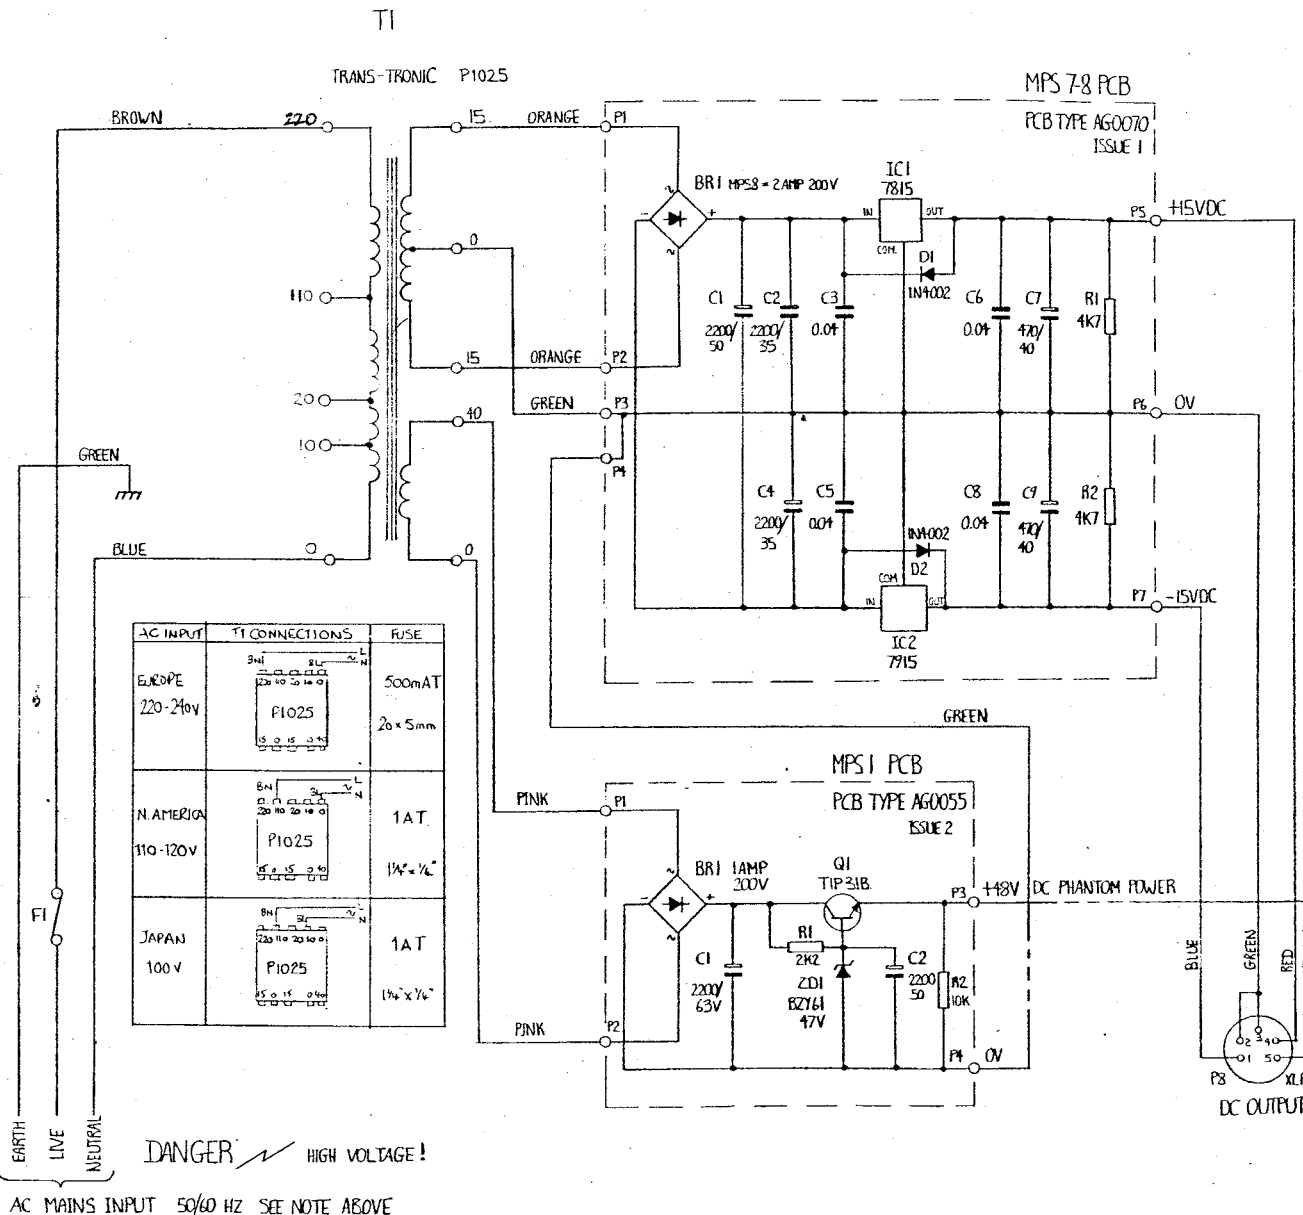

MPS8P DETAIL.

AC MAINS INPUT 50/60 HZ SEE NOTE ABOVE

No.	DESCRIPTION	CHKD	APPD.	DATE
6	MPS I C1 = 63V, FUSES = T, DC CABLE COLOURS			9-7-86
5	MPS8P ONLY.			12.84
REVISIONS				

AHB POWER SUPPLY MPS8P CIRCUITS AND GENERAL ARRANGEMENT INCLUDING PHANTOM POWER.

DRAWN	TRACED	CHECKED	APPROVED	DATE	SCALE
CP				9-9-82	

DRAWING No. 283 ISSUE 6